


MAIN SUPPLY, LATERAL,
CONTROL WIRE &
TRACER WIRE

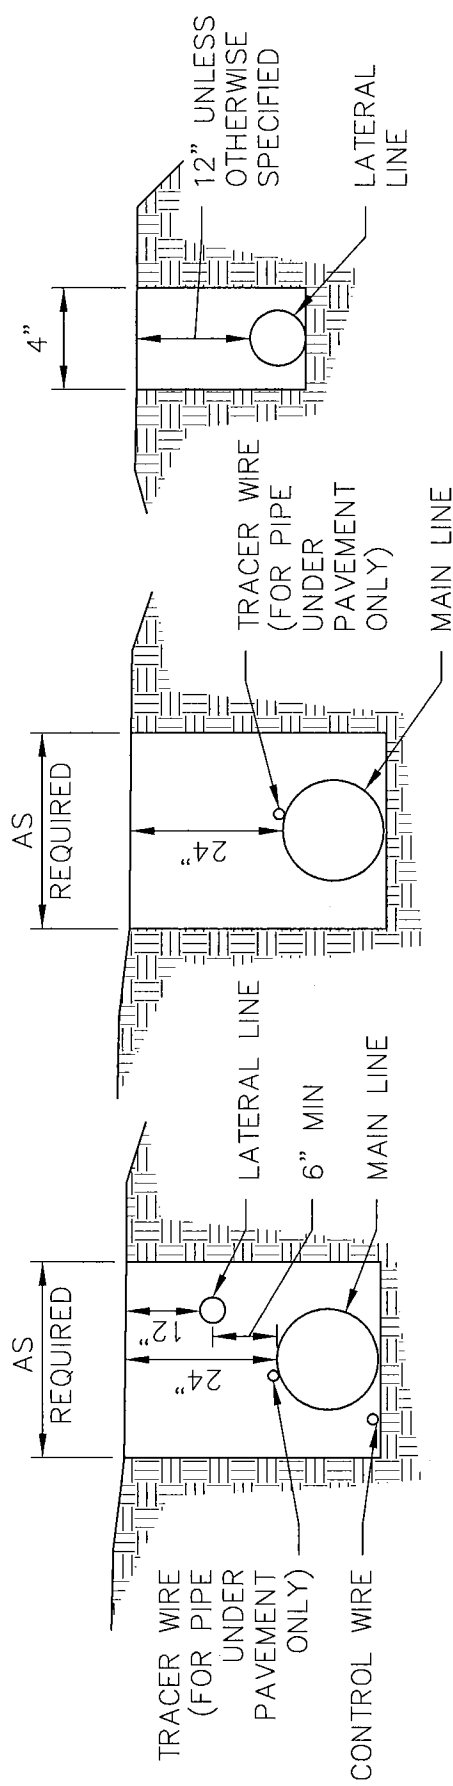

ALL PLASTIC PIPE
TO BE SNAKED IN
TRENCHES AS
SHOWN.

PLAN

- NOTES:
1. ALL TRENCH DEPTHS ARE MEASURED FROM TOP OF FINISH GRADE.
 2. TRACER WIRE SHALL BE REQUIRED ONLY WHEN PIPES ARE INSTALLED UNDER PAVEMENT.
 3. ALL PIPE TO BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS INSTALLATION SPECIFICATIONS.
 4. IF SPRINKLER HEAD AND NIPPLE HEIGHT EXCEED 11" LATERAL LINE DEPTH SHALL BE 18".
 5. INSTALL PIPE BEDDING UNDER PIPING, WHEN SPECIFIED.
 6. INSTALL SLEEVING UNDER PAVING PER PLANS.

DATE:	01/18/2007	NOT TO SCALE
REVISION	BY	APPROVED
		DATE

CITY OF ELK GROVE - PUBLIC WORKS

**IRRIGATION SYSTEM
TRENCHING**

APPROVED BY: _____

CITY ENGINEER

DRAWING NUMBER

L - 18

