


NOTES:

1. ALL SLOPES SHOWN ARE MAXIMUMS.
 2. ALL DIMENSIONS SHOWN ARE MINIMUMS.
 3. ALL RAMPS MUST BE LOCATED INSIDE CROSSWALKS OR IN FRONT OF STOP BARS.
 4. DETECTABLE WARNING IS PLACED IN THE RAMP AND AS PER DRAWING AR-3.2.
 5. ADD LAMP BLACK TO NEW CONCRETE AS DIRECTED BY ENGINEER. MATCH EXISTING COLOR.
- (A) STANDARD CURB HEIGHT TO MATCH EXISTING.
- (B) TOP OF RETAINING CURB TO MATCH ADJACENT RETAINING CURB ELEVATIONS CAN BE FLUSH WITH LANDING.
- (C) FROM THE FLOW LINE OUT THE RUNNING SLOPE CANNOT EXCEED 4.5% FOR A DISTANCE OF 4'.

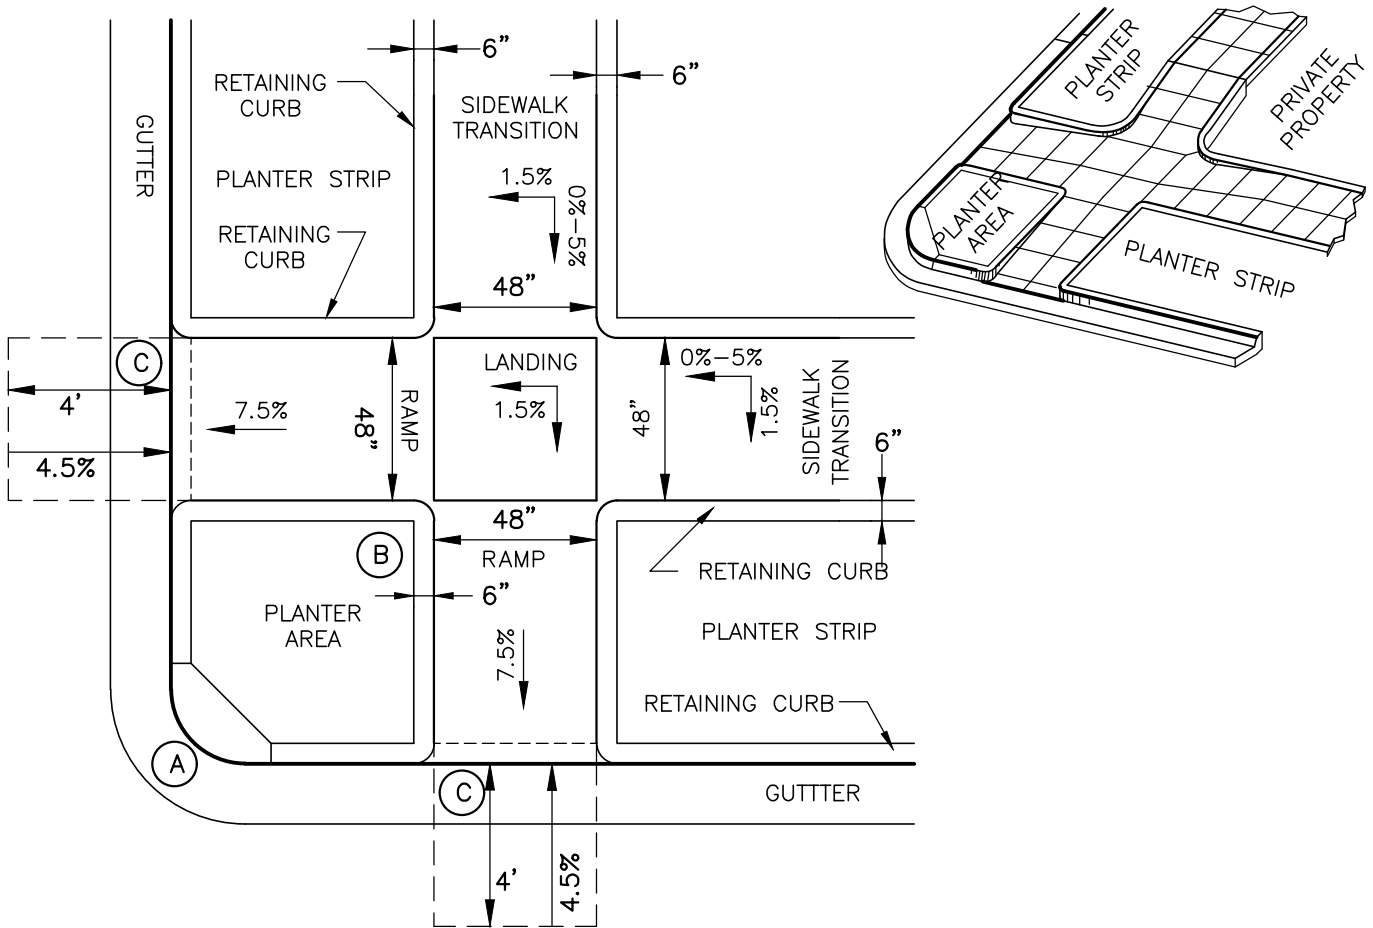

DATE: 09/22/2017		NOT TO SCALE	
REVISION	BY	APPROVED	DATE
1	LM	TW	07-18-2019

CITY OF ELK GROVE - PUBLIC WORKS

**DUAL PERPENDICULAR CURB
RAMPS WITH DETACHED SIDEWALK**

APPROVED BY:
Paul M. ... 1/16/2020
CITY ENGINEER DATE

DRAWING NUMBER
AR - 4.6

