


5 TO 6 FOOT SIDEWALK

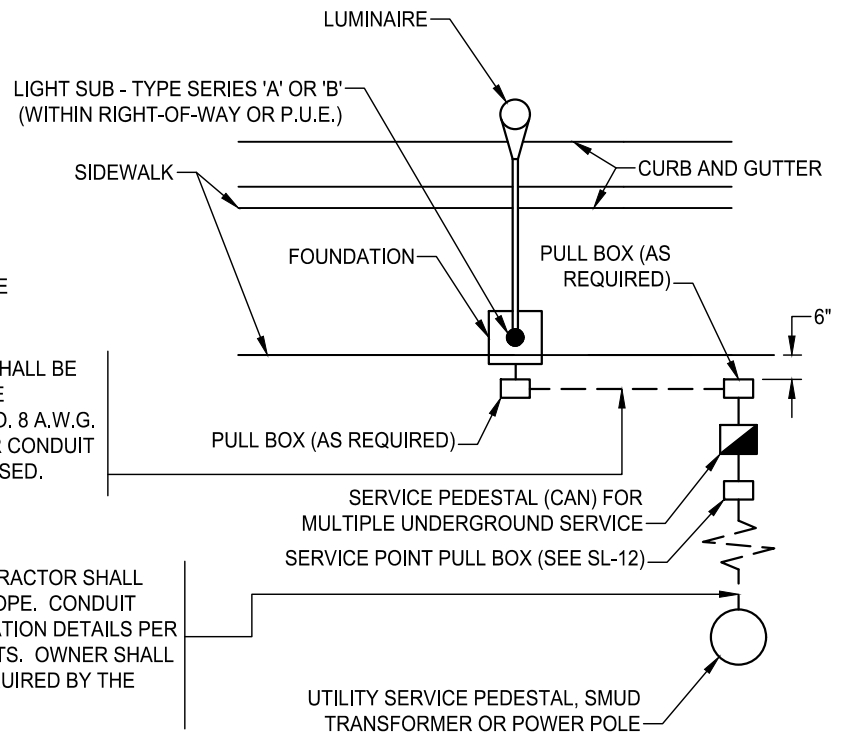

6 FOOT OR WIDER SIDEWALK

NOTES:

1. ALL CITY OWNED FACILITIES SHALL BE WITHIN RIGHT-OF-WAY (R/W) OR PUBLIC UTILITY EASEMENT (PUE).
2. SEE STANDARD DRAWING SL-12 FOR SERVICE POINT PULL BOX DETAILS AND WIRING DIAGRAM.
3. SEE STANDARD DRAWING SL-4 FOR PULL BOX DETAILS.
4. PHOTOCELLS SHALL BE INSTALLED ON THE TOP OF THE LUMINAIRE NEAREST THE SERVICE PEDESTAL OR SERVICE POINT.
5. THE SERVICING UTILITY WILL INSTALL AND MAINTAIN CONDUCTORS FROM THEIR TRANSFORMER, OR POWER POLE TO THE SERVICE POINT PULL BOX.

DATE: 09/22/2007		NOT TO SCALE	
REVISION	BY	APPROVED	DATE

CITY OF ELK GROVE - PUBLIC WORKS

**UNDERGROUND SERVICE
INSTALLATION**

APPROVED BY:

Robert M. Muddoch

CITY ENGINEER

10/24/2018

DATE



DRAWING NUMBER

SL - 7